


SITEMANAGER EQUIPMENT AND CONDUIT LAYOUT (TYPICAL)

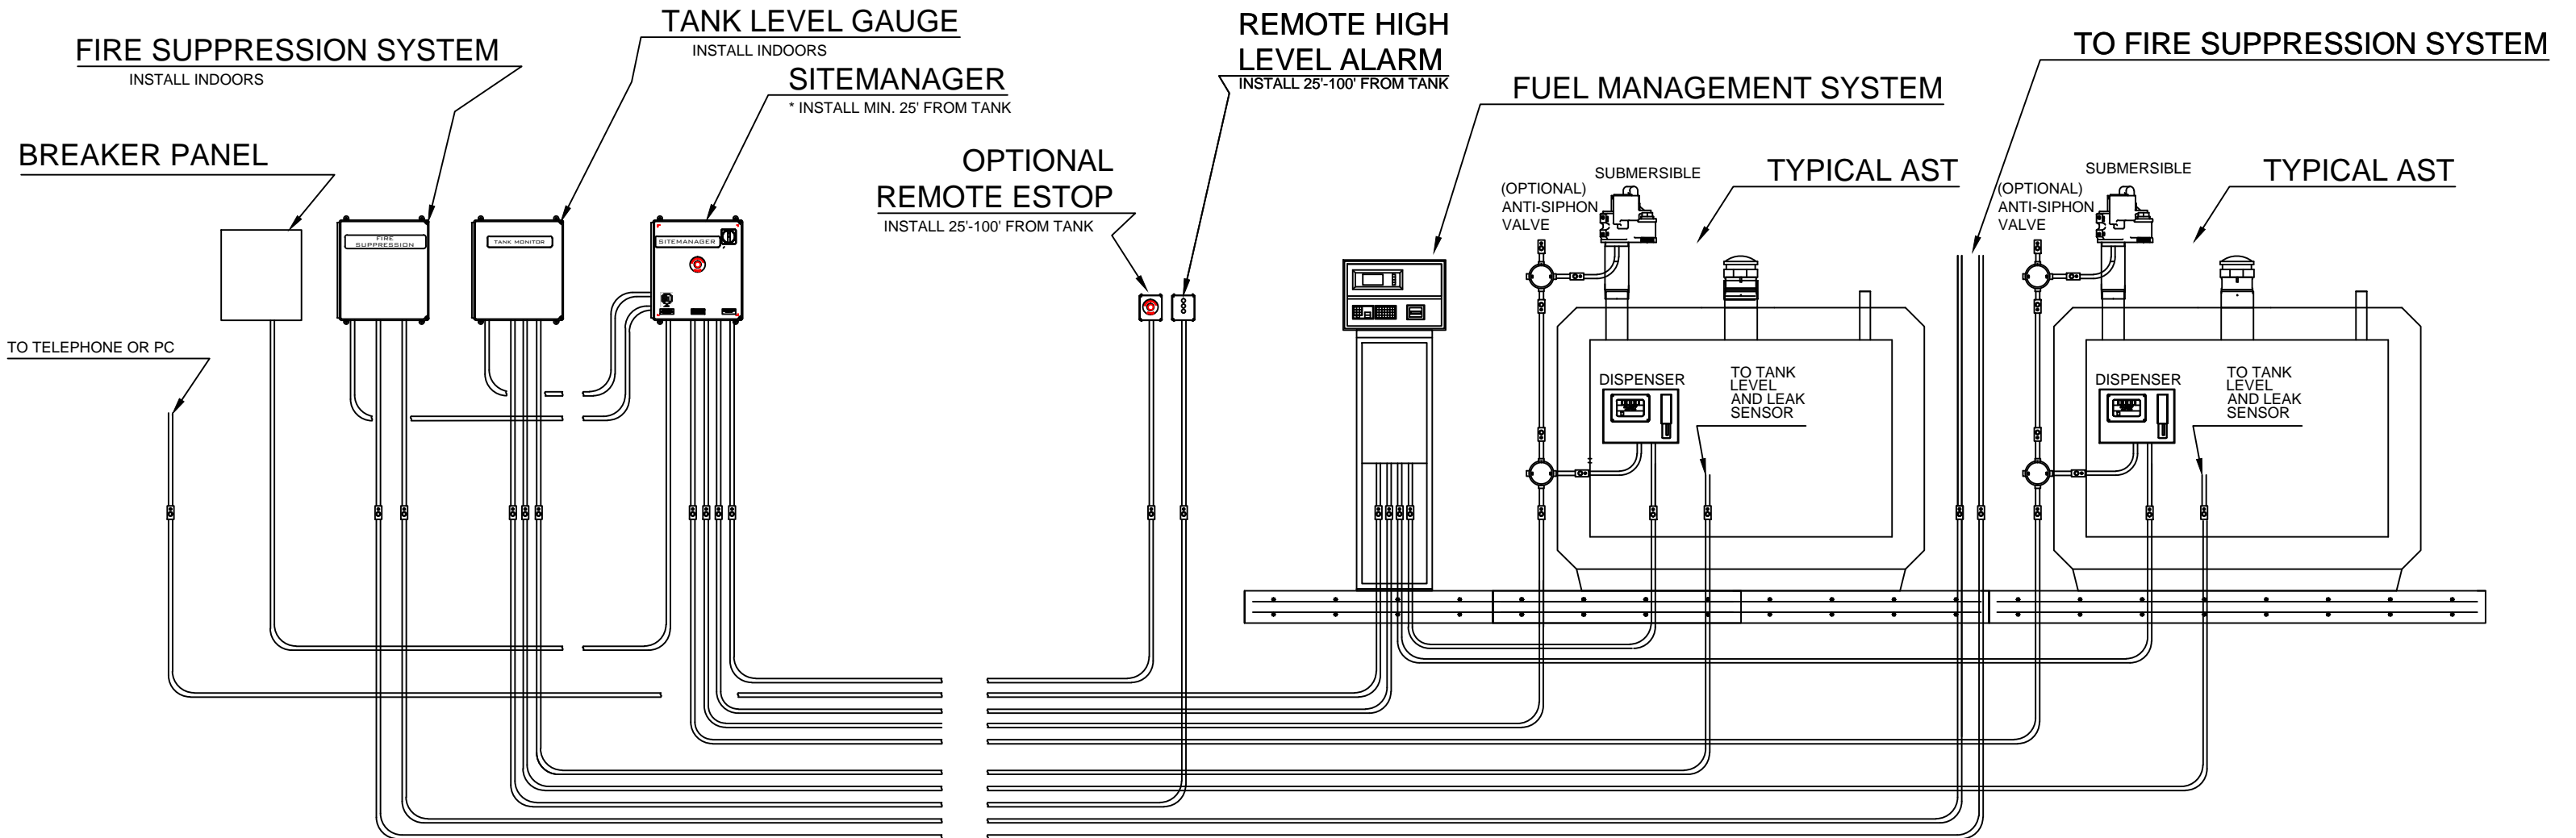

* INSTALL THE SITEMANAGER OUTDOORS 20 to 100 FEET AWAY VISIBLE FROM THE FUELING AREA. IF INSTALLED INDOORS OR NOT VISIBLE FROM THE FUELING AREA, AN ADDITIONAL REMOTE EMERGENCY STOP BUTTON MUST BE USED

REV.	DESCRIPTION	BY	CK.	DATE

DO NOT USE THIS PRINT FOR CONSTRUCTION UNLESS CERTIFIED AND DATED.

THIS DOCUMENT IS THE PROPERTY OF PETROPANELS.COM & LPS, Inc. DO NOT REPRODUCE, FURNISH TO OTHERS, OR USE FOR OTHER THAN PURPOSE INTENDED WITHOUT EXPRESS WRITTEN CONSENT OF PETROPANELS.COM ALL WHOSE RIGHTS ARE HEREIN RESERVED.

DWR:JLM
DATE: 01/21/12
CK. JLM
DATE: -
APP'D. -
DATE: -




PetroPanels.com
Division of
Lakeside Petroleum Service, llc.
7677 Villa Maria
N. Syracuse, NY 13212
315-403-9985 ~ www.PetroPanels.com

TITLE :
SITEMANAGER
FUEL SYSTEM CONTROL PANEL
SITEMANAGER-230-1-115 50-60 HZ

DWG. NO. SMX-230-1-115 SH. 1 OF 1
SIZE A

SITEMANAGER EQUIPMENT AND CONDUIT LAYOUT (TYPICAL)

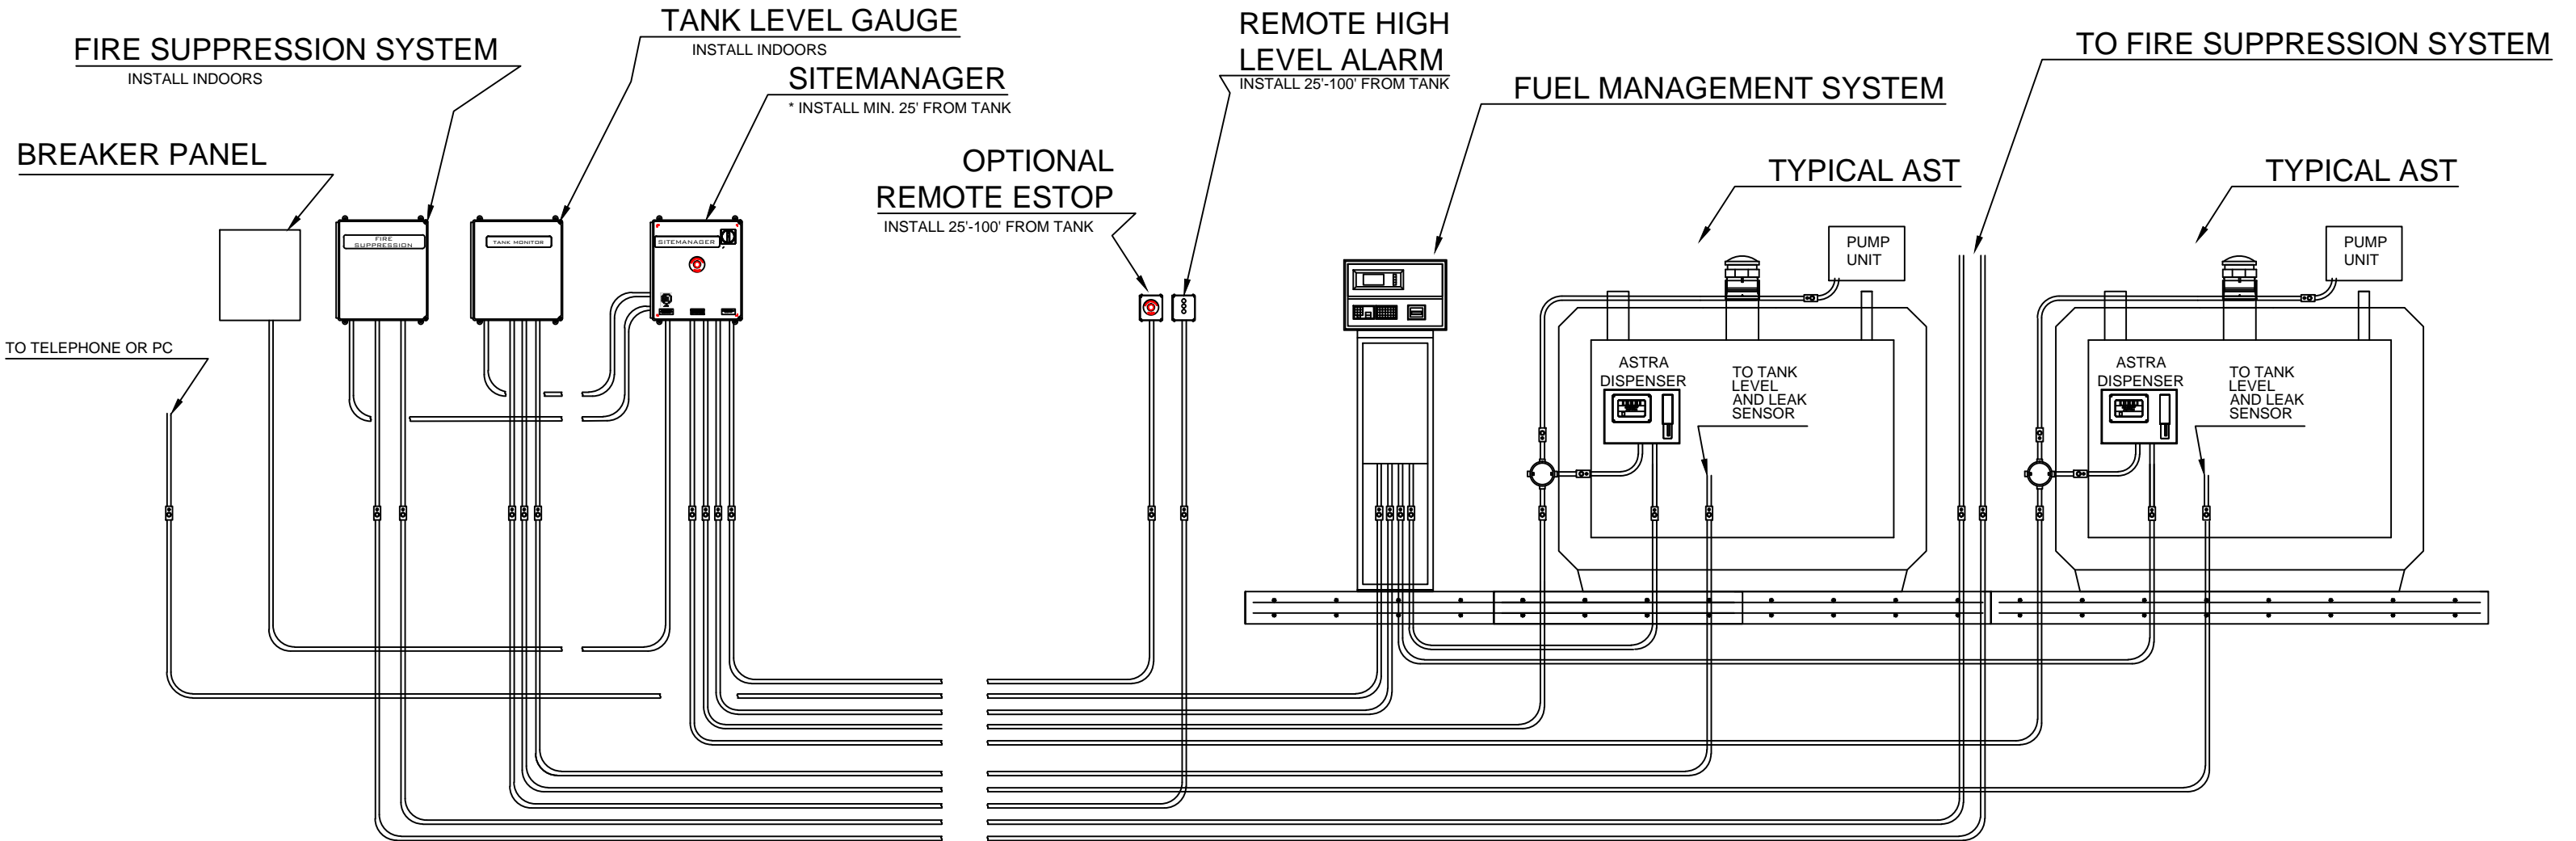

* INSTALL THE SITEMANAGER OUTDOORS 20 to 100 FEET AWAY VISIBLE FROM THE FUELING AREA. IF INSTALLED INDOORS OR NOT VISIBLE FROM THE FUELING AREA, AN ADDITIONAL REMOTE EMERGENCY STOP BUTTON MUST BE USED

REV.	DESCRIPTION	BY	CK.	DATE

DO NOT USE THIS PRINT FOR CONSTRUCTION UNLESS CERTIFIED AND DATED.

THIS DOCUMENT IS THE PROPERTY OF PETROPANELS.COM & LPS, Inc. DO NOT REPRODUCE, FURNISH TO OTHERS, OR USE FOR OTHER THAN PURPOSE INTENDED WITHOUT EXPRESS WRITTEN CONSENT OF PETROPANELS.COM ALL WHOSE RIGHTS ARE HEREIN RESERVED.

DWR-JLM
DATE: 01/21/12

CK. JLM
DATE: -

APP'D. -
DATE: -



PetroPanels.com
Division of
Lakeside Petroleum Service, Ilc.
7677 Villa Maria
N. Syracuse, NY 13212
315-403-9985 ~ www.PetroPanels.com

TITLE :


SITEMANAGER
FUEL SYSTEM CONTROL PANEL
SITEMANAGER-230-1-115 50-60 HZ

DWG. SIZE A

DWG. NO. SMX-230-1-115

SH. 1 OF 1

SITEMANAGER EQUIPMENT AND CONDUIT LAYOUT (TYPICAL)

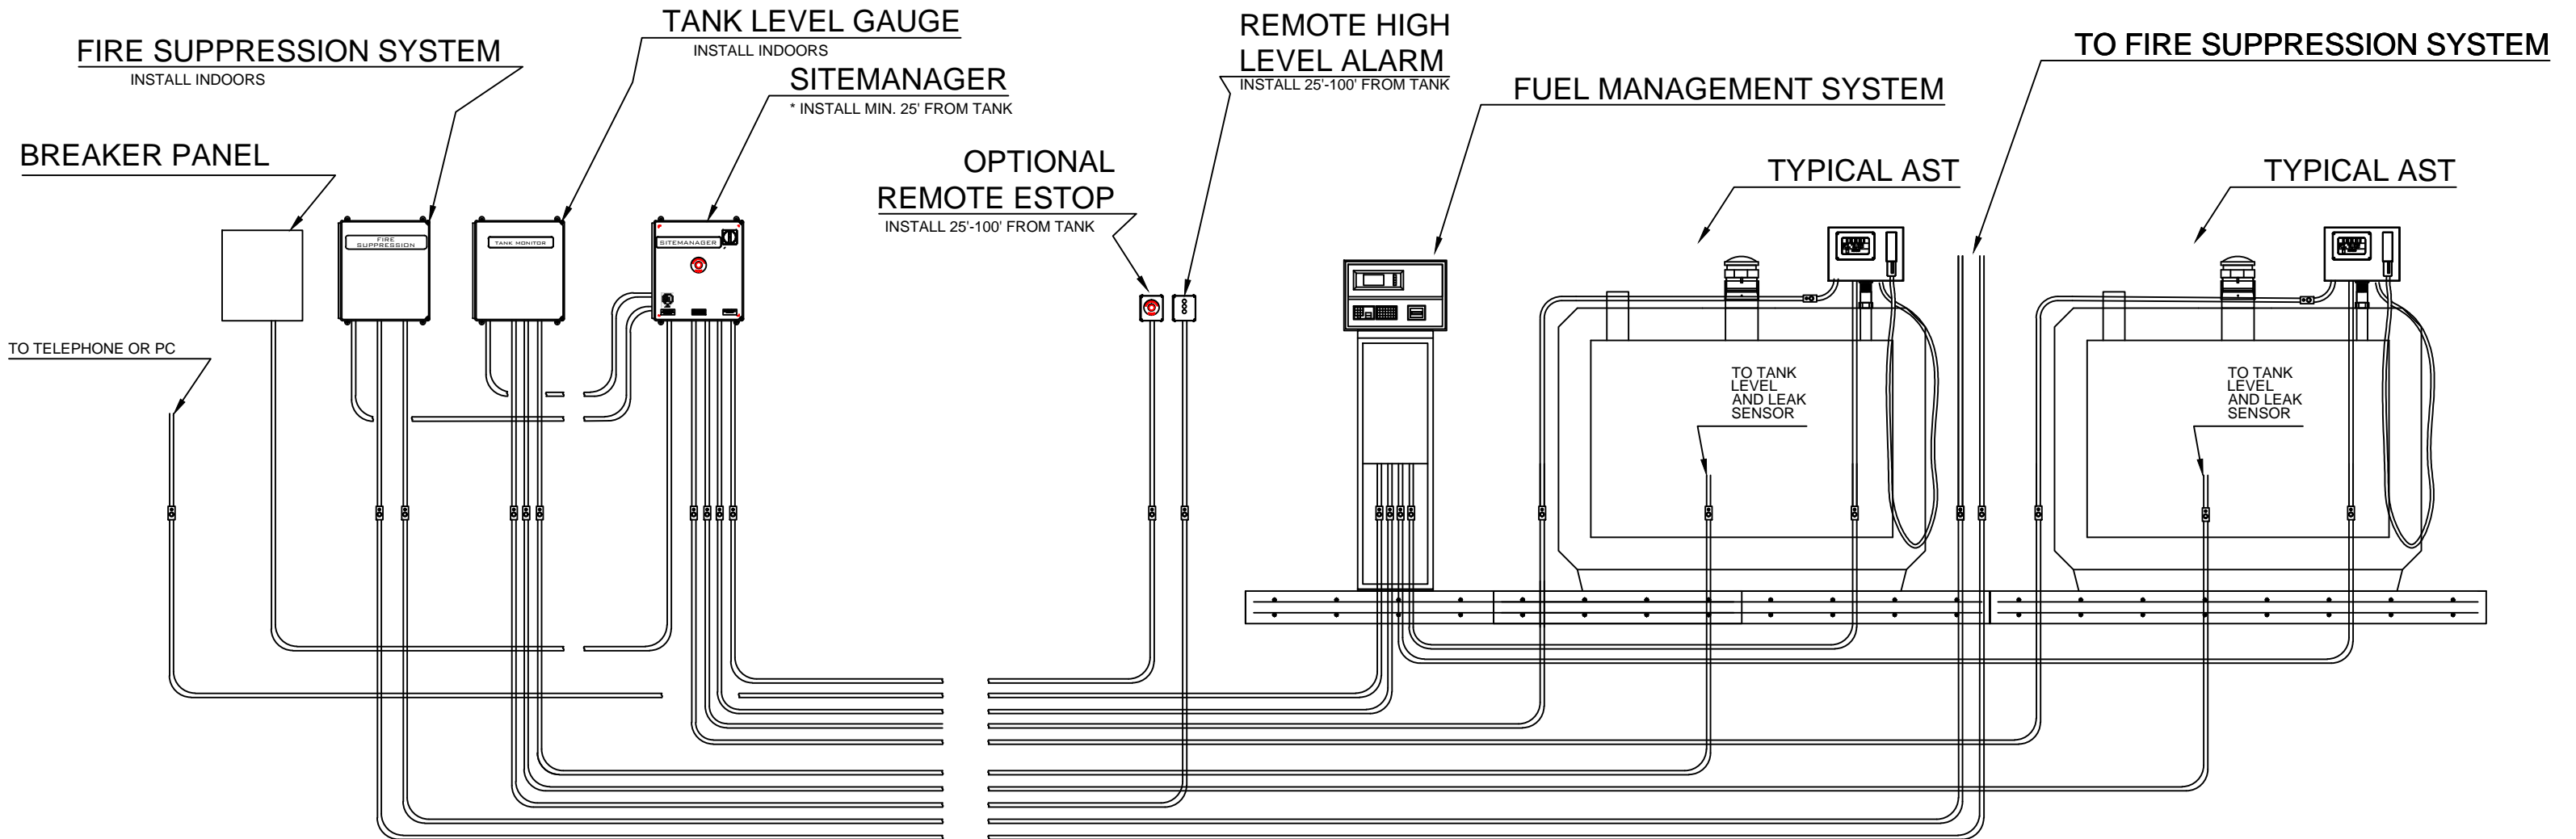

* INSTALL THE SITEMANAGER OUTDOORS 20 to 100 FEET AWAY VISIBLE FROM THE FUELING AREA. IF INSTALLED INDOORS OR NOT VISIBLE FROM THE FUELING AREA, AN ADDITIONAL REMOTE EMERGENCY STOP BUTTON MUST BE USED

REV.	DESCRIPTION	BY	CK.	DATE

DO NOT USE THIS PRINT FOR CONSTRUCTION UNLESS CERTIFIED AND DATED.

THIS DOCUMENT IS THE PROPERTY OF PETROPANELS.COM & LPS, Inc. DO NOT REPRODUCE, FURNISH TO OTHERS, OR USE FOR OTHER THAN PURPOSE INTENDED WITHOUT EXPRESS WRITTEN CONSENT OF PETROPANELS.COM ALL WHOSE RIGHTS ARE HEREIN RESERVED.

DWR:JLM
DATE: 01/21/12

CK: JLM
DATE: -

APP'D: -
DATE: -



PetroPanels.com
Division of
Lakeside Petroleum Service, llc.
7677 Villa Maria
N. Syracuse, NY 13212
315-403-9985 ~ www.PetroPanels.com

TITLE :
SITEMANAGER
FUEL SYSTEM CONTROL PANEL
SITEMANAGER-230-1-115 50-60 HZ

DWG. SIZE A
NO. SMX-230-1-115
SH. 1 OF 1